

親魚水槽および取水井戸水温

仲村伸次・岸本 学*1

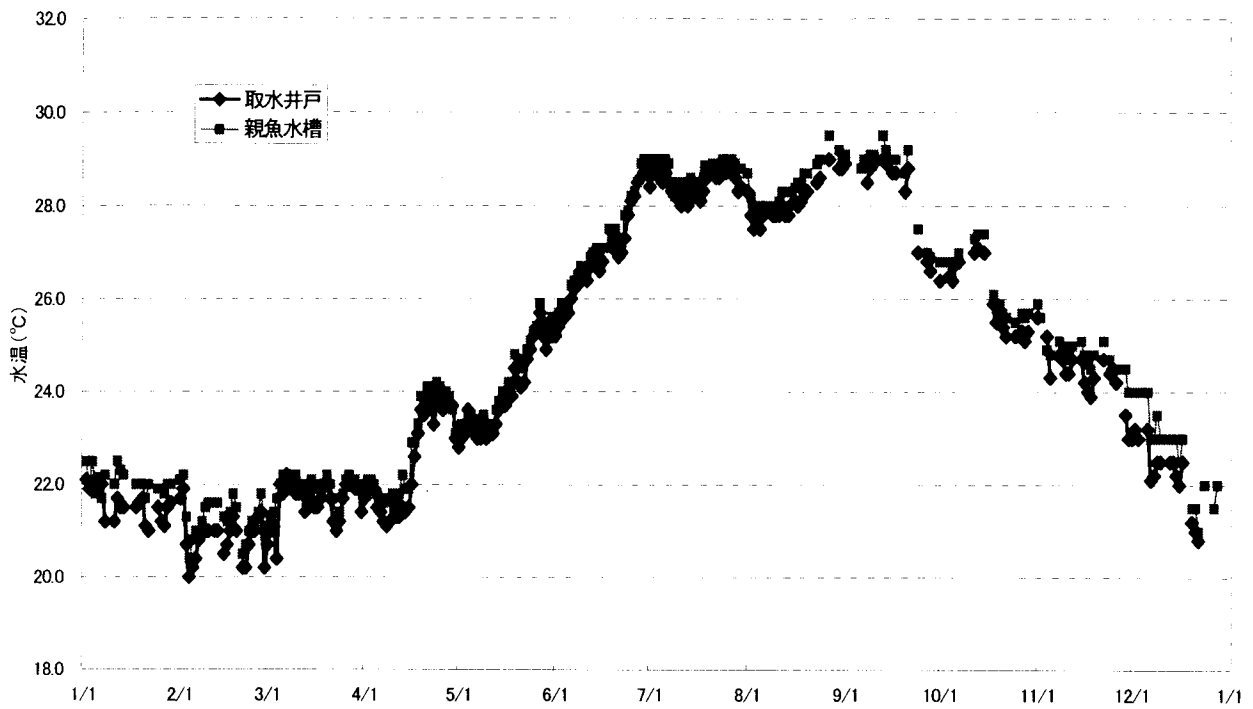


図1 平成11年(1999年)栽培漁業センター親魚水槽および取水井戸水温の推移

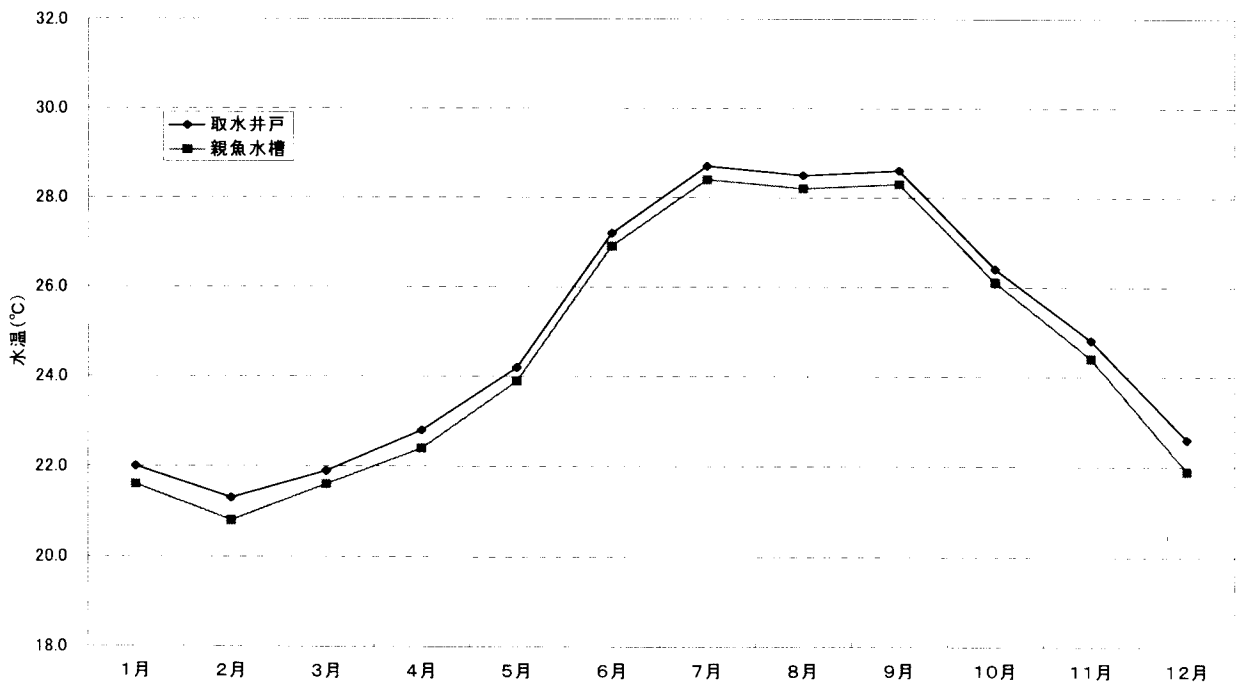


図2 平成11年(1999年)親魚水槽および取水井戸月平均水温の推移

1非常勤職員

表-1 平成11年(1999年)親魚水槽水温

日	月	1	2	3	4	5	6	7	8	9	10	11	12
1	—	21.7	20.7	21.7	22.8	25.2	28.4	28.3	28.9	26.4	25.6	23.0	
2	22.1	21.9	21.0	21.9	23.0	25.4	28.7	27.8	—	—	—	23.2	
3	21.9	20.7	21.1	21.9	23.1	25.7	28.7	27.5	—	—	—	23.0	
4	22.0	20.0	20.4	21.9	23.6	25.6	28.6	27.7	—	26.5	25.2	—	
5	22.1	20.2	22.0	21.5	23.2	25.7	28.5	27.5	—	26.4	24.3	—	
6	22.1	20.4	21.8	21.4	23.1	26.0	28.7	27.8	—	26.8	—	23.2	
7	22.0	20.8	22.2	21.2	23.0	26.2	28.5	27.9	—	26.8	—	22.1	
8	21.2	21.0	22.1	21.1	23.0	26.3	28.3	—	28.5	—	24.8	22.2	
9	—	21.0	21.9	21.2	23.2	26.6	28.2	27.8	28.8	—	24.7	22.5	
10	—	21.0	21.8	21.6	23.0	26.5	28.3	27.8	28.9	—	24.4	22.5	
旬平均	21.9	20.9	21.5	21.5	23.1	25.9	28.5	27.8	28.8	26.6	24.8	22.7	
11	21.2	—	21.8	21.3	23.1	26.4	28.0	27.8	—	—	24.4	—	
12	21.7	21.0	21.8	21.3	23.1	26.7	28.3	27.9	—	27.0	24.7	—	
13	21.5	21.0	21.4	21.5	23.3	27.0	28.0	27.8	29.0	27.1	—	22.5	
14	21.5	—	21.7	21.4	23.6	26.9	28.3	27.8	28.9	—	—	22.5	
15	—	20.5	21.9	21.5	23.7	26.6	28.2	—	—	27.0	24.7	22.2	
16	—	20.7	21.5	22.0	23.7	26.8	28.3	28.1	28.7	—	24.2	22.0	
17	—	21.0	21.5	22.6	24.0	—	28.1	28.0	28.7	—	24.0	22.5	
18	21.5	21.3	21.7	23.1	23.9	—	28.3	28.1	—	25.9	23.9	—	
19	21.6	21.0	22.0	23.6	24.5	27.1	28.6	28.3	—	25.5	24.3	—	
20	21.7	—	22.0	23.5	24.2	27.2	—	28.3	28.3	25.7	—	21.2	
旬平均	21.5	20.9	21.7	22.2	23.7	26.8	28.2	28.0	28.7	26.4	24.3	22.2	
21	21.1	20.2	21.7	23.8	24.1	26.9	28.7	—	28.8	25.4	—	21.0	
22	21.0	20.2	21.2	23.7	24.2	27.0	28.6	—	—	25.2	24.7	20.8	
23	—	20.7	21.0	23.3	24.7	27.3	28.6	28.5	—	—	—	20.7	
24	—	21.0	21.2	23.8	24.9	27.8	28.8	28.6	27.0	—	24.4	21.3	
25	21.5	21.0	21.7	23.7	25.2	28.1	28.7	—	—	25.2	24.5	20.9	
26	21.2	21.3	22.0	23.6	25.4	28.2	28.8	—	—	—	24.2	—	
27	21.1	21.4	22.0	23.7	25.7	28.5	28.7	29.0	26.8	25.3	—	20.0	
28	21.5	20.2	—	23.7	25.2	28.6	28.6	—	26.6	25.1	—	21.1	
29	21.6	—	21.9	23.7	24.9	28.7	28.3	—	—	25.3	23.5	21.5	
30	—	—	21.9	23.0	25.2	28.7	28.4	28.8	—	—	23.0	21.6	
31	—	—	21.4	—	25.2	—	—	28.8	—	—	—	21.9	
旬平均	21.3	20.8	21.6	23.6	25.0	28.0	28.6	28.7	27.3	25.3	24.1	21.1	
月平均	21.6	20.8	21.6	22.4	23.9	26.9	28.4	28.2	28.3	26.1	24.4	22.0	
年平均	24.6	最高水温	29.0	最低水温	20.0								

表-2 平成11年(1999年)取水井戸(地先)水温

日	月	1	2	3	4	5	6	7	8	9	10	11	12
1	—	22.1	21.1	22.0	23.2	25.6	28.8	28.7	29.1	26.8	25.9	24.0	
2	22.5	22.2	21.3	22.1	23.3	25.7	29.0	28.2	—	—	25.6	24.0	
3	22.0	21.3	21.4	22.1	23.3	25.9	29.0	27.9	—	—	—	24.0	
4	22.5	20.4	21.7	22.0	23.5	25.9	28.9	28.0	—	26.8	24.9	—	
5	21.8	20.8	22.0	21.8	23.5	25.9	28.9	28.0	—	26.7	24.8	—	
6	21.9	21.0	22.2	21.7	23.3	26.3	29.0	28.0	28.8	26.8	—	24.0	
7	21.7	21.0	22.2	21.6	23.4	26.4	28.9	28.0	29.0	27.0	—	23.0	
8	22.2	21.2	22.2	21.7	23.3	26.5	28.5	—	29.0	—	25.1	23.0	
9	—	21.5	22.0	21.7	23.5	26.7	28.2	28.0	29.1	—	25.0	23.5	
10	—	21.6	22.2	21.8	23.3	26.5	28.5	28.0	29.1	—	24.7	23.0	
旬平均	22.1	21.3	21.8	21.9	23.4	26.1	28.8	28.1	29.0	26.8	25.1	23.6	
11	22.0	—	22.0	21.6	23.2	26.6	28.2	28.1	—	—	24.8	—	
12	22.5	21.6	22.0	21.8	23.3	26.9	28.5	28.3	—	27.3	25.0	—	
13	22.3	21.6	21.8	22.2	23.6	27.0	28.2	28.0	29.5	27.4	—	23.0	
14	22.2	—	22.0	21.9	23.8	27.1	28.6	28.0	29.2	—	—	23.0	
15	—	21.3	22.1	21.9	24.0	27.0	28.5	28.3	—	27.4	25.1	23.0	
16	—	21.2	22.0	22.9	24.0	27.1	28.5	28.4	29.0	—	24.8	22.5	
17	—	21.4	21.9	22.9	24.2	27.1	28.5	28.5	29.0	—	24.6	23.0	
18	22.0	21.8	21.9	23.3	24.2	27.5	28.6	28.5	—	26.1	24.5	—	
19	22.0	21.5	22.0	23.9	24.8	27.3	28.8	28.7	—	25.8	24.8	—	
20	22.0	—	22.2	23.9	24.7	27.5	—	28.7	28.7	25.9	—	21.5	
旬平均	22.1	21.5	22.0	22.6	24.0	27.1	28.5	28.4	29.1	26.7	24.8	22.7	
21	21.7	20.5	22.0	24.1	24.5	27.3	28.9	—	29.2	25.7	—	21.5	
22	22.0	20.7	21.7	24.0	24.7	27.2	28.8	—	—	25.6	25.1	21.0	
23	—	21.0	21.3	24.0	24.9	27.8	28.8	28.9	—	—	—	—	
24	—	21.2	21.4	24.2	25.1	27.9	29.0	29.0	27.5	—	24.7	22.0	
25	21.9	21.1	21.8	24.1	25.3	28.2	29.0	—	—	25.5	24.5	—	
26	21.9	21.4	22.1	23.9	25.4	28.3	29.0	—	—	—	24.5	—	
27	21.8	21.8	22.2	24.0	25.9	28.5	29.0	29.5	27.0	25.7	—	21.5	
28	22.0	20.9	—	23.9	25.5	28.9	28.9	—	26.9	25.6	—	22.0	
29	22.0	—	22.1	23.6	25.3	29.0	28.8	—	—	25.7	24.5	—	
30	—	—	22.0	23.1	25.4	28.9	28.8	29.2	—	—	24.0	—	
31	—	—	21.9	—	25.6	—	—	29.0	—	—	—	—	
旬平均	21.9	21.1	21.9	23.9	25.2	28.2	28.9	29.1	27.7	25.6	24.6	21.6	
月平均	22.0	21.3	21.9	22.8	24.2	27.2	28.7	28.5	28.6	26.4	24.8	22.6	
年平均	24.9	最高水温	29.5	最低水温	20.4								