

表-1 平成13年(2001年)親魚水槽水温

日	月	4	5	6	7	8	9	10	11	12	1	2	3	日
1		21.0	23.0	23.4	29.4	30.2	—	27.2	—	23.0	21.6	20.5	20.8	1
2		21.1	23.1	23.1	29.7	30.1	—	27.4	—	23.2	—	20.4	21.3	2
3		21.1	23.0	23.3	29.4	30.1	29.3	27.2	—	23.5	20.3	20.5	21.4	3
4		21.2	22.0	23.5	29.1	30.0	29.2	27.2	—	23.7	20.5	20.4	21.2	4
5		21.2	22.7	24.3	28.9	30.0	29.5	27.2	—	23.2	21.1	20.4	21.1	5
6		21.3	23.0	24.8	28.9	30.1	29.6	27.1	—	23.2	21.2	20.4	20.8	6
7		21.3	23.1	25.1	29.0	30.2	29.2	27.2	—	22.8	21.3	20.6	19.4	7
8		21.4	23.0	25.1	29.0	30.0	—	27.2	—	22.7	20.6	20.5	20.1	8
9		21.6	23.1	25.2	29.2	30.0	—	27.0	—	22.5	20.0	20.5	19.9	9
10		21.6	23.0	25.4	29.5	30.4	28.4	27.1	—	22.7	20.4	20.4	—	10
旬平均		21.3	22.9	24.3	29.2	30.1	29.2	27.2	—	23.1	20.8	20.5	20.7	
11		21.7	22.6	25.7	29.5	30.7	28.5	26.6	—	22.8	21.3	19.0	20.3	11
12		21.6	22.4	26.1	29.6	30.7	28.3	26.7	—	22.9	21.2	18.5	20.4	12
13		21.1	22.3	26.1	29.9	30.7	28.1	26.4	—	22.9	—	—	20.7	13
14		21.3	21.3	26.5	29.8	30.6	28.1	26.2	—	22.0	21.6	19.5	21.0	14
15		21.4	22.4	26.3	29.8	30.4	—	26.4	—	21.9	22.0	20.4	21.2	15
16		21.7	22.2	26.3	29.9	30.4	27.7	—	23.4	21.8	22.3	20.4	21.0	16
17		21.4	22.8	26.5	29.8	30.3	27.6	26.5	23.4	22.5	22.2	20.4	20.6	17
18		21.7	22.9	26.8	30.2	—	27.4	26.5	23.4	22.7	21.8	20.0	20.8	18
19		21.7	23.3	27.0	30.3	—	27.6	26.5	23.5	22.2	22.0	19.4	20.5	19
20		21.7	22.7	27.4	30.3	29.4	26.6	26.4	23.5	22.0	21.3	19.3	21.0	20
旬平均		21.5	22.5	26.5	29.9	30.4	27.8	26.5	23.4	22.4	21.7	19.7	20.8	
21		21.2	23.2	27.6	30.4	29.3	26.6	26.4	23.7	22.0	21.3	19.5	21.8	21
22		21.1	23.6	27.9	30.5	29.1	—	27.0	23.7	21.2	19.3	20.1	21.4	22
23		22.0	23.4	27.9	30.3	29.3	26.9	27.0	23.0	21.3	20.5	20.6	21.4	23
24		22.1	23.3	28.1	30.5	29.2	26.6	26.8	23.0	21.2	20.0	20.6	21.0	24
25		22.3	23.3	28.1	30.7	29.5	26.4	—	23.1	21.2	20.6	20.3	20.4	25
26		22.2	23.4	28.2	30.6	—	26.5	—	23.1	20.8	21.1	20.2	20.7	26
27		21.8	23.8	28.2	30.1	—	26.6	—	23.0	21.1	—	20.4	21.4	27
28		22.0	23.8	28.4	29.5	29.6	26.7	—	23.1	21.0	20.5	20.4	21.5	28
29		22.5	23.4	28.7	29.8	29.5	26.9	—	23.0	21.0	19.5	—	21.5	29
30		22.8	23.5	29.0	29.9	29.5	27.3	—	23.3	—	20.0	—	21.4	30
31		—	23.7	—	30.1	29.8	—	—	—	21.2	20.0	—	—	31
旬平均		24.8	28.9	30.1	29.6	27.1	26.7	23.2	21.2	20.4	20.8	6.0	21.3	
月最高		22.8	23.8	29.0	30.7	30.7	29.6	27.4	23.7	23.7	22.3	20.6	21.8	
月最低		21.0	21.3	23.1	28.9	29.1	26.4	26.2	23.0	20.8	19.3	18.5	19.4	
月平均		21.6	23.0	26.3	29.8	30.0	27.7	26.8	23.3	22.2	20.9	20.1	20.9	
年平均		24.4	最高水温	30.7	最低水温	18.5								

表-2 平成13年(2001年)取水井戸水温

日	月	4	5	6	7	8	9	10	11	12	1	2	3	日
1		21.8	23.4	23.8	29.6	30.6	—	27.6	26.0	23.6	21.1	20.8	20.9	1
2		21.6	23.6	24.0	30.1	30.5	—	27.7	26.0	23.7	21.6	20.8	21.2	2
3		21.5	23.6	24.0	29.9	30.6	29.4	27.5	26.3	23.7	21.4	20.6	21.6	3
4		21.7	23.3	23.8	29.2	30.3	29.6	27.5	25.9	23.8	21.6	20.7	21.4	4
5		21.6	23.1	24.5	29.2	30.2	29.7	27.2	25.7	23.7	21.5	20.8	21.3	5
6		21.8	23.0	24.9	29.2	30.6	29.7	27.3	25.3	23.8	21.8	20.4	21.1	6
7		21.8	23.3	25.2	29.2	30.7	29.6	26.9	24.8	23.1	21.7	20.9	19.9	7
8		21.9	23.2	25.3	29.7	30.8	—	26.9	25.0	23.0	21.0	20.8	20.3	8
9		22.0	23.4	25.3	29.5	30.8	—	27.1	25.0	23.0	20.8	20.8	21.4	9
10		22.0	23.3	25.6	29.8	30.8	28.2	27.4	24.8	23.2	21.7	20.8	21.5	10
旬平均		21.8	23.3	24.6	29.5	30.6	29.4	27.3	25.5	23.5	21.4	20.7	21.1	
11		22.1	23.0	26.0	29.9	30.7	28.3	26.9	25.0	23.3	21.9	19.5	20.7	11
12		22.0	22.9	26.2	30.1	30.8	28.3	26.8	24.6	23.3	21.9	19.6	20.4	12
13		21.8	22.8	26.4	30.3	30.6	28.2	26.7	24.5	23.3	21.8	20.2	20.8	13
14		21.9	22.9	26.8	30.2	30.6	28.0	26.8	24.4	22.7	21.7	20.3	20.9	14
15		22.0	22.8	26.7	30.2	30.2	—	26.4	24.0	22.7	22.0	20.6	21.0	15
16		22.1	22.9	26.6	30.2	30.3	—	26.6	23.6	22.8	22.3	20.5	21.0	16
17		22.0	23.2	26.8	30.2	30.1	27.8	26.6	24.0	22.9	22.3	20.6	20.9	17
18		22.2	23.1	27.0	30.5	—	27.6	26.0	24.1	23.0	22.0	20.3	20.0	18
19		22.1	23.1	27.1	30.7	—	27.0	26.6	23.7	22.8	21.8	20.0	20.8	19
20		22.1	23.4	27.5	30.7	29.0	26.7	26.8	23.9	22.6	21.8	19.8	20.9	20
旬平均		22.0	23.0	26.7	30.3	30.3	27.7	26.6	24.2	22.9	22.0	20.1	20.7	
21		22.5	23.4	27.8	30.8	28.8	27.0	26.8	23.7	22.8	21.5	20.0	21.1	21
22		22.5	24.1	28.0	30.8	29.0	27.0	27.0	23.8	21.8	20.8	20.3	21.3	22
23		22.4	23.6	28.1	30.8	29.2	26.7	27.0	23.7	21.0	20.8	20.8	21.5	23
24		22.5	23.6	28.3	30.8	29.1	26.6	26.9	23.7	21.3	20.8	21.0	21.0	24
25		22.9	23.4	28.0	30.7	29.4	26.7	26.8	23.7	21.5	21.3	20.7	20.7	25
26		22.4	23.6	28.1	30.6	—	26.8	26.7	23.2	21.5	21.3	20.7	20.8	26
27		22.3	24.3	28.0	30.1	—	27.0	26.5	22.9	21.7	21.2	20.8	21.6	27
28		22.4	24.0	28.8	30.0	29.6	26.9	26.8	23.2	21.6	21.3	20.8	21.4	28
29		22.5	23.7	28.9	30.2	29.4	27.1	26.6	23.3	21.9	20.6	—	21.3	29
30		23.1	23.8	29.0	30.2	29.6	27.6	26.2	23.4	21.7	20.9	—	21.6	30
31		—	23.9	—	30.4	29.8	—	26.6	—	20.9	20.7	—	21.7	31
旬平均		22.6	23.8	28.3	30.5	29.3	26.9	26.7	23.5	21.6	21.0	20.6	21.3	
月最高		23.1	24.3	29.0	30.8	30.8	29.7	27.7	26.3	23.8	22.3	21.0	21.7	
月最低		21.5	22.8	23.8	29.2	28.8	26.6	26.0	22.9	20.9	20.6	19.5	19.9	
月平均		22.1	23.4	26.6	30.1	30.1	27.8	26.9	24.4	22.6	21.4	20.5	21.0	
年平均		24.7	最高水温	30.8	最低水温	19.5								

親魚水槽及び取水井戸水温

濱川 薫



図1 平成13年(2001年)栽培漁業センター親魚水槽及び取水井戸水温の推移

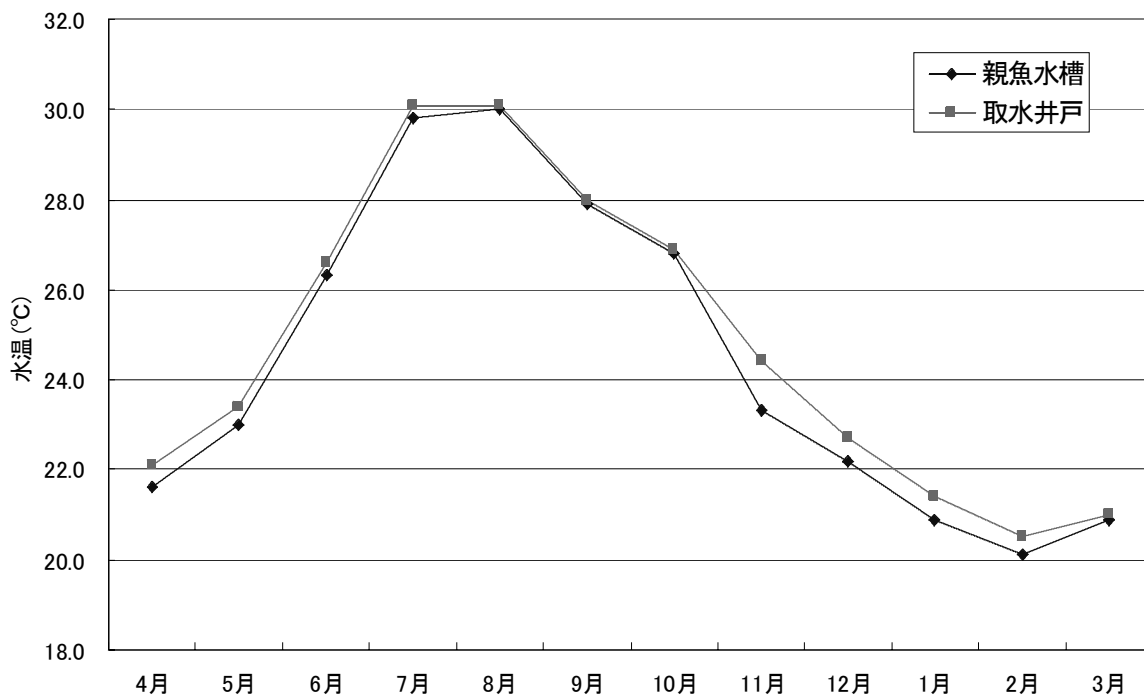


図2 平成13年(2001年)親魚水槽及び取水井戸平均水温の推移