

資料 親魚水槽及び取水井戸水温

平成14年(2002年) 親魚水槽水温

日	月	4	5	6	7	8	9	10	11	12	1	2	3	日
1		21.5	24.1	-	27.8	27.5	28.0	27.1	25.3	23.0	20.7	20.6	22.9	1
2		21.6	24.6	24.6	27.9	27.6	28.2	26.9	25.1	22.8	20.9	20.5	22.1	2
3		21.8	24.4	25.5	27.3	27.7	28.2	26.9	24.6	23.0	21.2	20.2	21.9	3
4		21.9	24.5	25.4	27.3	27.8	28.2	27.0	23.8	23.2	20.7	20.2	21.5	4
5		21.6	24.6	26.1	25.8	27.9		27.1	24.1	23.2	20.5	19.8	21.0	5
6		22.0	24.9	26.1	26.7	28.0	26.7	27.2	24.1	23.2	20.6	19.2	21.1	6
7		22.3	25.0	25.0	27.0	28.1	26.7	27.3	24.4	23.5	21.0	19.9	20.9	7
8		22.0	25.2	25.0	27.3	28.1	26.8	26.8	24.6	23.5	20.7	20.3	20.1	8
9		22.0	25.4	25.3	27.1	28.1	27.0	26.2	23.9	22.5	20.7	20.6	20.1	9
10		21.6	25.4	25.7	27.3	28.3	27.1	26.0	23.8	21.6	20.6	20.9	20.2	10
旬平均		21.8	24.8	25.4	27.2	27.9	27.4	26.9	24.4	23.0	20.8	20.2	21.2	
11		21.5	25.7	25.9	27.3	28.3		26.1	23.9	21.8	20.2		19.8	11
12		21.5	25.4	26.3	27.5	28.4	27.3	26.2	24.3	21.9	20.1	21.1	19.8	12
13		21.4	25.3	26.4	27.6	28.5	27.2	26.3	24.3	21.8	20.3	20.4	20.2	13
14		21.5	25.4	26.1	27.6	28.3	27.1	26.4	24.2	21.5	20.5	20.4	20.5	14
15		21.7	25.6	26.0	26.8	28.4	27.1	26.6	24.4	21.7	20.3	20.5	20.8	15
16		22.2	25.5	26.0	26.5	28.4	27.4	26.6	24.4	21.9	20.3	20.7	21.2	16
17		22.6	25.5	26.2	26.7	28.3	27.5	26.7	24.2	22.1	20.4	20.7	21.6	17
18		22.4	25.0	26.1	26.7	28.3	27.6	26.7	23.8	22.1	20.6	21.0	21.9	18
19		21.6	25.4	26.1	26.9	28.4	27.5	26.8	22.8	22.3	20.7	21.0	21.4	19
20		22.2	24.6	26.0	27.0	28.4	27.4	26.6	23.4	22.2	20.1	20.2	21.0	20
旬平均		21.9	25.3	26.1	27.1	28.4	27.3	26.5	24.0	21.9	20.4	20.7	20.8	
21		22.6	24.5	26.5	27.1	28.3	27.1	26.6	23.8	22.3	20.0	20.2	21.0	21
22		23.3	24.6	27.0	27.0	28.3	26.9	26.4	22.8	22.2	20.4	20.5	21.0	22
23		23.5	25.0	27.3	27.1	28.3	26.6	26.1	23.8	22.2	20.5	20.8	20.7	23
24		23.6	24.8	27.4	26.9	28.4	26.3	25.8	23.7	22.2	20.2	21.2	20.8	24
25		23.6	24.5	27.6	27.0	28.6	26.2	25.6	23.1	22.2	20.6	20.8	20.9	25
26		23.4	24.5	27.8	26.9	28.5	26.4	25.6	22.5	21.3	20.7	20.9	20.9	26
27		22.7	24.5	27.6	26.9	28.9	26.6	25.3	22.0	21.0	20.7	22.1	21.1	27
28		23.1	24.6	27.3	27.1	29.0	27.1	25.0	22.4	21.0	20.2	22.6	21.1	28
29		23.5	24.7	27.3	27.2	29.0	27.2	25.1	22.7	21.0	19.8		21.1	29
30		23.5	25.1	27.6	27.4	28.5	27.3	25.2	23.0	21.2	19.3		21.2	30
31		/	25.3	/	27.4	28.1	/	25.2	/	21.3	20.0		21.4	31
旬平均		23.3	24.7	27.3	27.1	28.5	26.8	25.6	23.0	21.6	20.2	21.1	21.0	
月最高		23.6	25.7	27.8	27.9	29.0	28.2	27.3	25.3	23.5	21.2	22.6	22.9	
月最低		21.4	24.1	24.6	25.8	27.5	26.2	25.0	22.0	21.0	19.3	19.2	19.8	
月平均		22.3	25.0	26.3	27.1	28.3	27.2	26.3	23.8	22.2	20.4	20.6	21.0	
年平均		24.2	最高水温	29.0	最低水温	19.2								

平成14年(2002年) 取水井戸水温

日	月	4	5	6	7	8	9	10	11	12	1	2	3	日
1		21.7	23.6	24.9	27.3	27.0	27.9	26.8	25.2	22.8	20.9	20.6	22.8	1
2		21.8	24.0	24.9	27.5	27.2	28.2	26.8	25.0	22.9	20.9	19.7	22.4	2
3		21.8	23.9	24.9	26.1	27.3	28.1	26.7	24.6	22.6	21.0	20.3	21.7	3
4		21.9	24.0	24.9	25.3	28.3	27.9	26.9	23.4	23.1	20.3	20.1	21.2	4
5		21.8	24.3	25.0	25.7	27.5		27.1	23.8	23.0	20.8	19.7	20.9	5
6		21.8	24.5	24.8	26.5	27.8	26.1	27.1	23.9	23.0	20.5	19.8	20.9	6
7		22.4	24.5	24.7	26.7	27.9	26.3	27.1	24.5	23.3	21.0	19.9	20.8	7
8		21.9	24.9	24.7	27.0	27.9	26.5	26.4	24.2	23.4	20.8	20.2	19.7	8
9		21.9	24.8	25.2	27.0	27.9	27.0	26.1	23.8	22.1	20.4	20.5	20.2	9
10		21.8	24.9	25.7	27.0	27.9	27.1	25.9	23.8	21.8	20.5	20.8	20.1	10
旬平均		21.9	24.3	25.0	26.6	27.7	27.2	26.7	24.2	20.7	20.2	20.2	21.1	
11		21.8	25.1	26.1	26.9	28.0		26.1	23.9	21.8	20.2	20.9	19.7	11
12		21.8	25.0	25.9	27.0	28.0	26.9	26.2	24.1	21.9	19.9	20.9	19.9	12
13		21.9	24.8	-	27.0	28.0	26.5	26.3	24.1	21.5	19.9	20.4	20.2	13
14		21.7	25.0	25.9	26.9	28.0	27.1	26.4	24.0	21.0	20.6	20.5	20.4	14
15		21.9	25.1	25.9	26.9	28.0	27.0	26.4	24.1	21.6	19.9	20.2	20.8	15
16		22.3	25.6	25.7	26.0	28.0	27.1	26.5	24.2	22.0	20.3	20.5	20.9	16
17		22.3	25.0	25.8	26.4	27.9	27.3	26.5	24.2	21.9	20.3	20.7	21.4	17
18		22.2	24.9	25.7	26.5	28.0	27.2	26.7	23.4	22.0	20.3	20.8	21.7	18
19		-	25.0	25.8	26.5	28.1	27.0	26.7	23.5	22.1	20.5	20.9	20.9	19
20		22.2	24.3	26.1	26.6	28.1	27.1	26.4	23.4	22.1	19.9	20.2	20.9	20
旬平均		22.0	25.0	25.9	26.7	28.0	27.0	26.4	23.9	21.8	20.2	20.6	20.7	
21		22.5	24.5	26.1	26.9	28.0	26.5	26.5	23.8	22.2	20.1	19.3	20.8	21
22		22.7	24.2	26.6	27.0	28.3	26.9	26.1	23.5	21.8	20.2	20.5	20.8	22
23		23.0	24.5	26.9	-	28.0	26.2	25.6	23.7	21.7	20.2	20.6	20.3	23
24		23.1	24.5	27.9	26.9	28.2	26.0	26.0	23.6	22.1	20.5	21.0	20.8	24
25		23.2	24.3	27.1	26.5	28.2	26.1	25.8	23.0	22.2	20.7	20.9	20.8	25
26		23.0	24.1	27.1	26.7	-	26.2	25.6	22.3	21.2	20.7	21.4	20.9	26
27		22.5	24.5	27.0	26.5	28.7	26.4	25.2	21.1	21.0	21.0	22.4	20.9	27
28		22.7	24.5	27.5	26.8	28.7	27.0	25.0	22.4	20.7	20.3	22.9	21.2	28
29		23.0	24.5	-	-	28.3	27.0	25.1	22.8	20.6	19.9		20.5	29
30		23.0	24.9	27.0	-	27.9	27.0	24.8	22.9	21.1	19.9		20.9	30
31		23.0	24.9	/	27.1	28.0	/	24.9	/	20.9	20.4		21.2	31
旬平均		22.9	24.5	27.0	26.8	28.2	26.5	25.5	22.9	21.4	20.4	21.1	20.8	
月最高		23.2	25.6	27.9	27.5	28.7	28.2	27.1	25.2	23.4	21.0	22.9	22.8	
月最低		21.7	23.6	24.7	25.3	27.0	26.0	24.8	21.1	20.6	19.9	19.3	19.7	
月平均		22.3	24.6	25.9	26.7	28.0	26.9	26.2	23.7	22.0	20.4	20.6	20.9	
年平均		24.0	最高水温	28.7	最低水温	19.3								

### 親魚水槽及び取水井戸水温

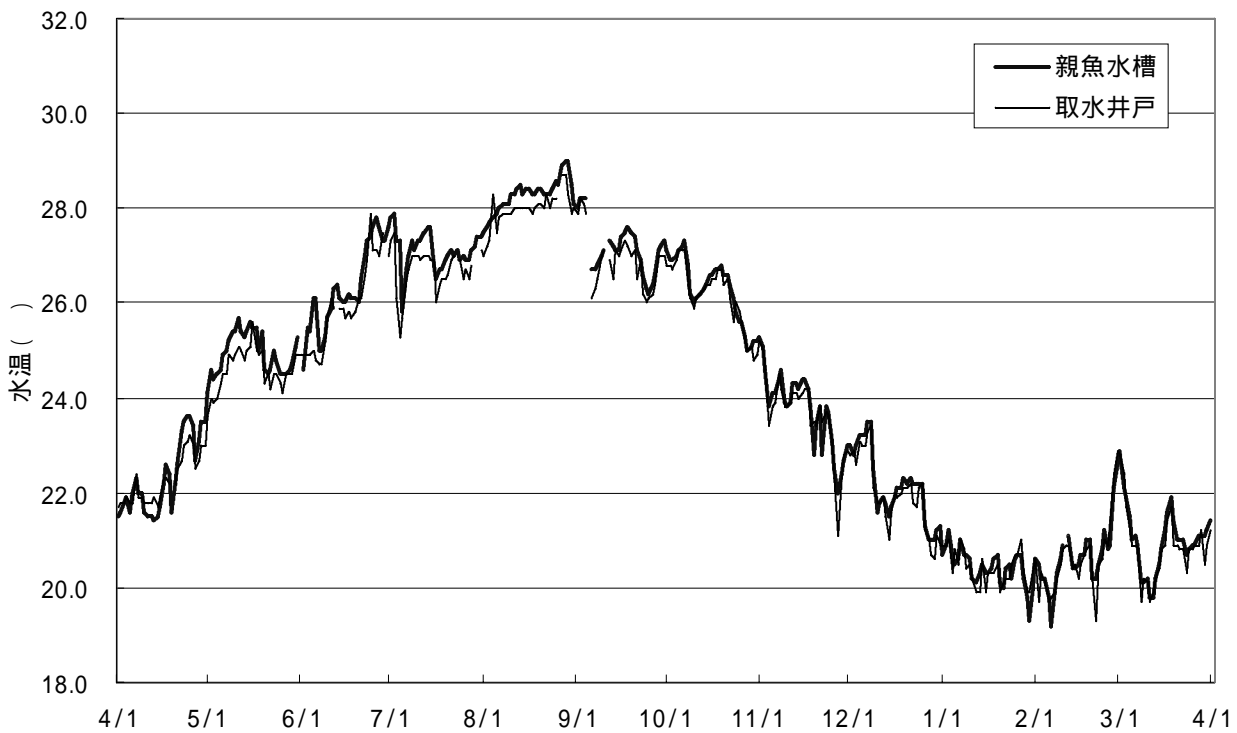


図1 平成14年(2002年)栽培漁業センター親魚水槽及び取水井戸水温の推移

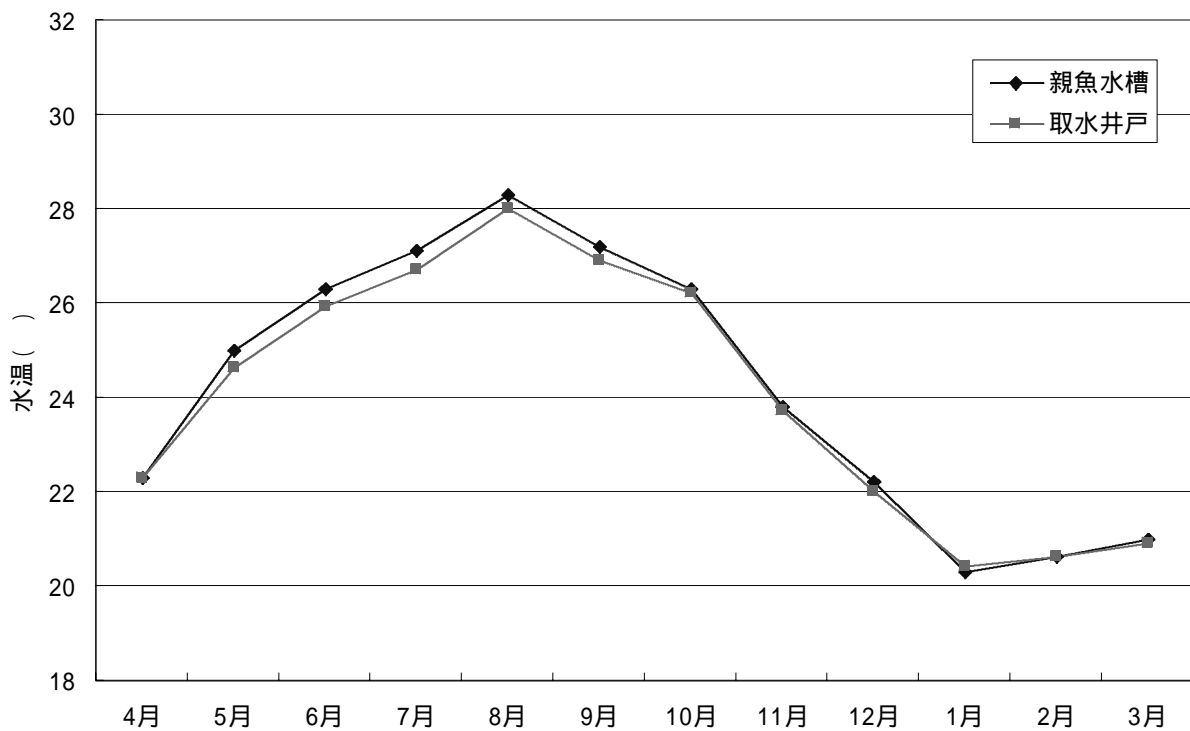


図2 平成14年(2002年)親魚水槽及び取水井戸月平均